

**NFPA 415**  
**Standard on**  
**Airport Terminal Buildings,**  
**Fueling Ramp Drainage,**  
**and Loading Walkways**

**1997 Edition**



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101  
An International Codes and Standards Organization

Copyright ©  
National Fire Protection Association, Inc.  
One Batterymarch Park  
Quincy, Massachusetts 02269

## **IMPORTANT NOTICE ABOUT THIS DOCUMENT**

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

## **NOTICES**

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*<sup>®</sup> Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

## **Licensing Policy**

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

**1. Adoption by Reference**—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

**2. Adoption by Transcription**—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

**3. Scope of License Grant**—The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 1997 NFPA, All Rights Reserved

**NFPA 415**

**Standard on**

**Airport Terminal Buildings,  
Fueling Ramp Drainage,  
and Loading Walkways**

**1997 Edition**

This edition of NFPA 415, *Standard on Airport Terminal Buildings, Fueling Ramp Drainage, and Loading Walkways*, was prepared by the Technical Committee on Airport Facilities and acted on by the National Fire Protection Association, Inc., at its Fall Meeting held November 18–20, 1996, in Nashville, TN. It was issued by the Standards Council on January 17, 1997, with an effective date of February 7, 1997, and supersedes all previous editions.

This edition of NFPA 415 was approved as an American National Standard on February 7, 1997.

**Origin and Development of NFPA 415**

NFPA 415, *Standard on Aircraft Fueling Ramp Drainage*, was first adopted in 1961. Subsequent editions were published in 1966, 1973, 1977, 1983, 1987, and 1992.

NFPA 416, *Standard on Construction and Protection of Airport Terminal Buildings*, was first adopted in 1962. Subsequent editions were published in 1967, 1972, 1973, 1975, 1983, 1987, and 1993.

NFPA 417, *Standard on Construction and Protection of Aircraft Loading Walkways*, was first adopted in 1963. Subsequent editions were published in 1968, 1973, 1977, 1985, and 1990.

The 1997 edition of NFPA 415 is a combination of the above three documents and has a new title, *Standard on Airport Terminal Buildings, Fueling Ramp Drainage, and Loading Walkways*.

## Technical Committee on Airport Facilities

**L. M. Krasner**, *Chair*  
Factory Mutual Research Corp., MA [I]

**James M. Dewey**, *Secretary*  
Cohocton, NY [SE]

**Gene E. Benzenberg**, *Vice Chair*  
Alison Control, Inc., NJ [M]

**Nathaniel J. Addleman**, Boeing Comm. Airplane, KS [U]  
**Thomas G. Burk**, Federal Express Corp., TN [U]  
**David J. Burkhardt**, Carter & Burgess, Inc., TX [SE]  
**Bruce G. Carpenter**, Aero Automatic Sprinkler Co., AZ [IM]  
Rep. NFPA Fire Service Section  
**James Devonshire**, ChemGuard Inc., TX [M]  
**James D. Dick**, Kemper Nat'l Insurance Cos., WA [I]  
**Steve C. Dryden**, Poole Fire Protection Engr, Inc., KS [SE]  
**Joseph E. Gott**, U.S. Naval Facilities Engr Command, VA [E]  
**Richard R. Harrington**, United Airlines (SFOSY), CA [C]  
**James M. Ingalls**, Industrial Risk Insurers, CT [I]  
Rep. Industrial Risk Insurers  
**Elwin G. Joyce**, KY Division of Bldg. Code Enforcement, KY [E]  
Rep. Fire Marshals Assn. of North America  
**Dennis C. Kennedy**, Rolf Jensen & Assoc., Inc., IL [SE]  
**Thomas J. Lett**, Albuquerque Fire & Safety Assoc., NM [SE]  
Rep. NFPA Fire Service Section

**Fred M. Linde**, Nat'l Foam Inc., PA [M]  
**Edward V. Lockwood**, U.S. Army Corps of Engr, VA [U]  
**Christy J. Marsolo**, Grinnell Fire Protection Systems Co., GA [M]  
**John J. O'Sullivan**, British Airways, England [C]  
**Mark Oliszewicz**, Schirmer Engr Corp., IL [SE]  
**Maurice M. Pilette**, Mechanical Designs Ltd, MA [SE]  
**Randy D. Pope**, Burns & McDonnell Engr Co., MO [U]  
**Alan Rhome**, Port Authority of NY & NJ, NJ [E]  
Rep. Airport Operators Council Int'l Inc.  
**Douglas Rice**, Central Sprinkler Corp., PA [M]  
Rep. Nat'l Fire Sprinkler Assn.  
**Michael T. Skinner**, Massachusetts Port Authority Fire/Rescue, MA [E]  
**Doug Toupalik**, Ansul Inc., WI [M]  
Rep. Fire Equipment Mfrs. Assn. Inc.  
**Fred K. Walker**, U.S. Air Force, FL [U]

### Alternates

**Michael E. Aaron**, Rolf Jensen & Assoc., Inc., IL [SE]  
(Alt. to D. C. Kennedy)  
**Joseph A. Behnke**, Ansul Inc., WI [M]  
(Alt. to D. Toupalik)  
**Delbert R. Chase, Jr.**, Federal Express Corp., TN [U]  
(Alt. to T. G. Burk)  
**Jeffrey W. DeLong**, Industrial Risk Insurers, CA [I]  
(Alt. to J. M. Ingalls)  
**Robert D. Grausam**, Kemper Nat'l Insurance Cos., NY [I]  
(Alt. to J. D. Dick)  
**Kevin M. Green**, Schirmer Engr Corp., CA [SE]  
(Alt. to M. Oliszewicz)  
**Frank M. E. Hughes**, British Airways, England [C]  
(Alt. to J. J. O'Sullivan)  
**Keith C. Kremkow**, Johnson & Higgins, IL [I]  
(Voting Alt. to J&H Rep.)

**John E. Loehle**, Air Nat'l Guard Readiness Center, MD [U]  
(Alt. to F. K. Walker)  
**Rahe Loftin**, Carter & Burgess, Inc., TX [SE]  
(Alt. to D. J. Burkhardt)  
**Al Mazur**, Transport Canada - Airports Group, ON [E]  
(Voting Alt. to TC-AG Rep.)  
**Robert C. Merritt**, Factory Mutual Research Corp., MA [I]  
(Alt. to L. M. Krasner)  
**Jack Poole**, Poole Fire Protection Engr, Inc., KS [SE]  
(Alt. to S. C. Dryden)  
**V. G. Pyrpyris**, Port Authority of NY & NJ, NY [E]  
(Alt. to A. Rhome)  
**John B. Ramsey**, The Viking Corp., MI [M]  
(Alt. to D. Rice)  
**Terry L. Victor**, Grinnell Fire Protection Systems Co., MD [M]  
(Alt. to C. J. Marsolo)

### Nonvoting

**J. Walter Coon**, Black and Veatch, MO  
(Member Emeritus)

**Jerome Lederer**, CA  
(Member Emeritus)

**Mark T. Conroy**, NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in membership may have occurred. A key to classifications is found at the back of this document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for documents on fire safety for the construction and protection at airport facilities involving construction engineering but excluding airport fixed fueling systems.

## Contents

<p><b>Chapter 1 Administration</b> ..... 415- 4</p> <p>  1-1 Scope ..... 415- 4</p> <p>  1-2 Purpose ..... 415- 4</p> <p>  1-3 Applicability ..... 415- 4</p> <p>  1-4 Definitions ..... 415- 4</p> <p><b>Chapter 2 Airport Terminal Buildings</b> ..... 415- 4</p> <p>  2-1 General ..... 415- 4</p> <p>  2-2 Heating, Ventilating,     and Air Conditioning ..... 415- 5</p> <p>  2-3 Exits ..... 415- 5</p> <p>  2-4 Electrical ..... 415- 5</p> <p>  2-5 Fire Protection ..... 415- 5</p> <p><b>Chapter 3 Aircraft Fueling Ramp Drainage</b> ..... 415- 6</p> <p>  3-1 Aircraft Fueling Ramp Slope     and Drain Design ..... 415- 6</p>	<p>  3-2 Drain and Separator Maintenance ..... 415- 6</p> <p><b>Chapter 4 Aircraft Loading Walkways</b> ..... 415- 6</p> <p>  4-1 Basic Design ..... 415- 6</p> <p>  4-2 Requirements for All Aircraft     Loading Walkways ..... 415- 7</p> <p>  4-3 Materials ..... 415- 7</p> <p>  4-4 Fire Tests ..... 415- 7</p> <p>  4-5 Fire Suppression Systems ..... 415-10</p> <p><b>Chapter 5 Referenced Publications</b> ..... 415-10</p> <p><b>Appendix A Explanatory Material</b> ..... 415-11</p> <p><b>Appendix B Referenced Publications</b> ..... 415-16</p> <p><b>Index</b> ..... 415-17</p>
--	---

**NFPA 415****Standard on****Airport Terminal Buildings,  
Fueling Ramp Drainage,  
and Loading Walkways****1997 Edition**

**NOTICE:** An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 5 and Appendix B.

**Chapter 1 Administration**

**1-1 Scope.** This standard specifies the minimum fire protection requirements for the construction and protection of airport terminal buildings. It specifies the minimum requirements for the design and maintenance of the drainage system of an aircraft fueling ramp to control the flow of fuel that can be spilled on a ramp and to minimize the resulting possible danger. In addition, it contains the minimum requirements for the design, construction, and fire protection of aircraft loading walkways between the terminal building and aircraft.

**1-2\* Purpose.** The purpose of this standard is to provide a reasonable degree of protection for life and property from fire at airport terminal complexes.

Requirements applicable to ramp drainage systems are intended to limit the fire hazard from fuel spillage by the following:

(a) Controlling the spread of a fuel spill to limit exposure to buildings, aircraft loading walkways, concourses, or elevated structures in order to prevent the fuel's liquid or vapors from reaching a source of ignition or accumulating within structures

(b) Limiting the spread of the fuel spill over the ramp surface and preventing the transmission of vapors by the drainage system from exposing aircraft or other equipment parked or operating on the ramp

The purpose of this standard is also to specify minimum criteria for fire protection of aircraft loading walkways that can serve as an egress route from an aircraft in the event of a flammable liquid spill fire on the airport ramp exposing the walkway and the aircraft.

**1-3 Applicability.** It is not intended that the provisions of this document be applied to facilities, equipment, structures, or installations that were existing or approved for construction or installation prior to the effective date of the document, except in those cases where it is determined by the authority having jurisdiction that the existing situation involves a distinct hazard to life or adjacent property.

**1-4 Definitions.** For the purpose of this standard, terms shall be defined as follows:

**Aircraft Fueling Ramp.** Any outdoor area at an airport, including aprons and hardstands, where aircraft are normally fueled or defueled.

**Aircraft Loading Walkway.** An aboveground device through which passengers move between a point in an airport terminal building and an aircraft. Included in this category are walkways that are essentially fixed and permanently placed, or walkways that are essentially mobile in nature and that fold, telescope, or pivot from a fixed point at the airport terminal building.

**Airport Ramp.** Any outdoor area, including aprons and hardstands, where aircraft can be positioned, stored, serviced, or maintained, irrespective of the nature of the surface of the area.

**Airport Terminal Building.\*** A structure used primarily for air passenger enplaning or deplaning, including ticket sales, flight information, baggage handling, and other necessary functions in connection with air transport operations. This term includes any extensions and satellite buildings used for passenger handling or aircraft flight service functions. Aircraft loading walkways and "mobile lounges" are excluded.

**Approved.\*** Acceptable to the authority having jurisdiction.

**Authority Having Jurisdiction.\*** The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

**Listed.\*** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets identified standards or has been tested and found suitable for a specified purpose.

**Potential Fuel Spill Points.** The points on or around the aircraft or airport ramp where fuel can be released. These points include fueling hydrants, fuel servicing vehicles, fuel tank fill connections, fuel vent openings, and fuel dump valves.

**Satellite.** A structure that can be adjacent to but separated from the airport terminal building, accessible aboveground or through subway passages, and used to provide flight service operations, such as passenger check-in, waiting rooms, food service, enplaning or deplaning, etc.

**Shall.** Indicates a mandatory requirement.

**Should.** Indicates a recommendation or that which is advised but not required.

**Chapter 2 Airport Terminal Buildings****2-1 General.**

**2-1.1\*** Airport terminal buildings shall be of Type I, Type II, or Type IV construction, as defined in NFPA 220, *Standard on Types of Building Construction*.

**2-1.2\*** Interior finish shall be limited to that permitted in Class A places of assembly as specified in NFPA 101®, *Life Safety Code*®.

**2-1.3** Aircraft fueling facilities and ramps shall be designed in accordance with NFPA 407, *Standard for Aircraft Fuel Servicing*, and Chapter 3 of this standard.

**2-1.4** Belowgrade areas or blind spaces in airport terminal buildings shall be protected against flammable fuel or vapor penetration or shall be mechanically ventilated to provide at least four complete air changes per hour. The mechanical ventilation system shall be installed in accordance with Chapters 2 and 3 of NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*.

**2-1.5\*** Where potential fuel spill points are located less than 100 ft (30.5 m) horizontally from glazing material covered openings in airport terminal building walls facing the airport ramp, they shall be provided with an automatically activated water spray system or an automatically activated, listed fire shutter as follows:

(a) An automatically activated water spray system installed in accordance with NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*.

1. The system shall be designed to provide a density of at least 0.25 gpm/ft<sup>2</sup> [10.2 (L/min)/m<sup>2</sup>] over the exterior surface area of the glazing material.

2. Where multiple water spray systems are used, the water supply shall be capable of supplying all systems that could be expected to operate as a result of one fire incident.

3. The detection system design analysis shall include consideration of false alarms and detector response time.

(b) An automatically activated, listed fire shutter installed in accordance with its listing.

*Exception No. 1: Openings covered with glazing material that have the lowest part of the glazing material not less than 7 ft (2.1 m) above the finished floor level.*

*Exception No. 2: Openings covered with glazing material listed for use in a fire barrier and installed in accordance with the listing.*

## **2-2 Heating, Ventilating, and Air Conditioning.**

**2-2.1** Heating, ventilating, and air conditioning systems shall be installed in accordance with NFPA 31, *Standard for the Installation of Oil-Burning Equipment*; NFPA 54, *National Fuel Gas Code*; and NFPA 90A, *Standard for the Installation of Air Conditioning and Ventilating Systems*, as applicable.

**2-2.2\*** Air supply intake and exhaust openings for air conditioning or ventilating equipment serving the terminal building, if located on the ramp side, shall be not less than 10 ft (3 m) above the grade level of the ramp and shall be at least 50 ft (15.2 m) from any point of flammable vapor release.

**2-2.3\*** Openings to rooms containing coal-, gas-, or oil-fired equipment, or any rooms containing any other open flame device, that face the ramp side of the terminal shall be above ramp grade and 50 ft (15.2 m) from any point of flammable vapor release.

**2-2.4** Stacks or chimneys from a boiler, heater, or incinerator shall terminate at least 20 ft (6.1 m) above ramp grade and above the roof of the building. Stacks or chimneys from boil-

ers or heaters using solid fuel or from any incinerator shall be fitted with double screening to control fly ash and sparks. Such stacks or chimneys shall be located so the outlet is at least 100 ft (30.5 m) horizontally from any aircraft position or point of flammable vapor release.

**2-2.5** Incinerators shall conform to the requirements of Chapter 2 of NFPA 82, *Standard on Incinerators and Waste and Linen Handling Systems and Equipment*.

**2-2.6** Exhaust hood ventilation systems for restaurant and flight kitchens shall conform to the applicable portions of NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*.

## **2-3 Exits.**

**2-3.1** Airport terminal building means of egress shall conform to the requirements of NFPA 101, *Life Safety Code*.

**2-3.2\*** Exits that discharge onto an airport ramp and are provided solely for the purpose of meeting emergency egress requirements from public areas shall be placarded "Emergency Exit Only" in letters at least 2 in. (4.9 cm) high.

## **2-4 Electrical.**

**2-4.1** All electrical installations shall be in accordance with NFPA 70, *National Electrical Code*®.

**2-4.2** Ventilation and access openings for transformer or electrical service rooms or vaults located on the ramp side of an airport terminal building shall be located as outlined in 2-2.2.

## **2-5 Fire Protection.**

**2-5.1\* Sprinkler Systems.** The airport terminal building shall be provided with an automatic sprinkler system installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

*Exception: Terminal buildings with less than 12,000 ft<sup>2</sup> (1115 m<sup>2</sup>) total floor area for the assembly portion of the occupancy.*

**2-5.1.1** Passenger handling areas shall be classified as Ordinary Hazard Group 1 Occupancy, as defined in NFPA 13, *Standard for the Installation of Sprinkler Systems*, for the purpose of sprinkler system design.

**2-5.1.2\*** Other areas of the airport terminal building shall be classified in accordance with 1-4.7 of NFPA 13, *Standard for the Installation of Sprinkler Systems*, based on the occupancy of the area.

**2-5.1.3 Covered Plane-Loading Positions.** Airport terminal buildings having canopy areas or roofed-over recesses at aircraft loading positions that, in effect, place the aircraft totally or substantially under such canopies or roofs shall have these canopies or roofs protected by automatic sprinkler systems in accordance with NFPA 409, *Standard on Aircraft Hangars*.

**2-5.2 Fire Alarm and Communications Systems.** A fire alarm and communications system shall be installed as required by 8-3.4 of NFPA 101, *Life Safety Code*.

**2-5.2.1** Means to alert the public fire department or the airport fire station shall be available through manual fire alarm pull stations. Manual fire alarm services shall be installed in accordance with NFPA 72, *National Fire Alarm Code*.



**2-5.2.2\*** Annunciation for all building fire alarm signals shall be provided near the front entrance of the building.

*Exception: This annunciation shall not be required if the public fire department has two-way voice communication with a constantly attended location.*

**2-5.3 Fire Hydrants.** Fire hydrants shall be provided on both the ramp and street sides of airport terminal buildings. Such hydrants shall be located so that no portion of the terminal building is more than 500 ft (152.4 m) from a hydrant.

**2-5.4 Standpipe and Hose Systems.** Standpipe and hose systems shall be provided for all airport terminal buildings in excess of two stories [35 ft (10.7 m)] in height or 100 ft (30.5 m) in shortest horizontal dimension. Standpipe and hose systems shall be installed in accordance with NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*.

**2-5.4.1** Class I standpipe systems shall be provided in buildings protected throughout by an approved automatic sprinkler system. Each 2<sup>1</sup>/<sub>2</sub>-in. (63.5 mm) hose connection shall be equipped with a 2<sup>1</sup>/<sub>2</sub>-in. × 1<sup>1</sup>/<sub>2</sub>-in. (63.5-mm × 38.2-mm) reducer and cap.

**2-5.4.2** Class III standpipe systems shall be provided in non-sprinklered buildings. The exceptions in NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, for Class III systems shall be applicable to this requirement.

**2-5.5 Water Supply.** Water supply from public or private sources shall be adequate to supply maximum calculated sprinkler demand plus a minimum of 500 gpm (1893 L/min) for hose streams. The supply shall be available at the rate specified for a period of at least 1 hour.

**2-5.5.1\*** Main sizes shall be hydraulically calculated based on the total domestic and fire protection requirements. Mains shall be not less than 8 in. (20 cm) in diameter except that laterals shall be permitted to be 6 in. (15 cm) in diameter if not over 200 ft (61 m) long.

**2-5.5.2\*** Hydrants shall be readily accessible to fire-fighting vehicles traveling on surfaces adequate for supporting such vehicles.

**2-5.5.2.1** Hydrants shall be listed.

**2-5.5.2.2** Hydrants shall be located or protected to prevent mechanical or vehicular damage, including taxiing aircraft.

**2-5.5.2.3** Hydrants recessed into the ground shall have identifiers in the pavement to assist in their prompt location at night and by personnel who might not be familiar with the location of the hydrants.

**2-5.5.3\*** Water supply systems shall be regularly tested to ensure operation.

**2-5.6 Portable Fire Extinguishers.** Portable fire extinguishers shall be provided throughout the airport terminal building in accordance with NFPA 10, *Standard for Portable Fire Extinguishers*.

## Chapter 3 Aircraft Fueling Ramp Drainage

### 3-1 Aircraft Fueling Ramp Slope and Drain Design.

**3-1.1\*** Aircraft fueling ramps shall slope away from terminal buildings, aircraft hangars, aircraft loading walkways, or other

structures, with a minimum grade of 1 percent (1:100) for the first 50 ft (15.2 m). Beyond this distance, the ramp slope to drainage inlets shall be permitted to be reduced to a minimum of 0.5 percent (1:200).

**3-1.2\*** Aircraft fueling ramp drainage as specified herein shall be accomplished by the provisions of 3-1.1 in conjunction with the following:

- (a) The use of drain inlets with connected piping
- (b) The use of open-grate trenches

**3-1.3** Drainage inlets, where provided, shall be located a minimum of 50 ft (15.2 m) from structures outlined in 3-1.1.

**3-1.4** The drainage system of any aircraft fueling ramp shall be so designed that the fuel or its vapor cannot enter into the drainage system of buildings, areas utilized for automobile parking, public or private streets, or the public side of airport terminal or aircraft hangar structures. In no case shall the design allow fuel to collect on the aircraft fueling ramp or adjacent ground surfaces where it could constitute a fire hazard.

**3-1.5** The final separator or interceptor for the entire airport drainage system shall be designed to allow disposal of combustible or flammable liquids into a safely located, approved containment facility.

**3-1.6** Grates and drain covers shall be removable to facilitate cleaning and flushing.

**3-1.7\*** If open-grate drainage trenches are used as a collection means, such open trenches, including branches, shall not be over 125 ft (38.1 m) in length with a minimum interval of 6 ft (1.8 m) between open-trench sections to act as fire stops. Each 125-ft (38.1-m) section shall be individually drained through underground piping. Open trenches shall not be used where they are in the line of pedestrian or passenger traffic.

**3-1.8** Underground piping and components used in drainage systems shall be noncombustible and inert to fuel.

### 3-2 Drain and Separator Maintenance.

**3-2.1\*** Periodic maintenance checks shall be conducted of all ramp drainage systems and interceptors to ensure that they are clear of obstructions and function properly.

**3-2.2** Large volume flushing with water shall be conducted through appropriate drainage elements to purge the residual fuel from these drainage elements after any large fuel spill on the aircraft fueling ramp enters the drainage system.

## Chapter 4 Aircraft Loading Walkways

### 4-1 Basic Design.

**4-1.1** Each aircraft loading walkway installation shall be designed to provide a safe means of egress from the aircraft for a period of five minutes under fire exposure conditions equivalent to a free-burning jet fuel spill fire.

**4-1.2** Protection of the aircraft loading walkway shall be accomplished by one of the following methods:

- (a) Construction design meeting the requirements of Sections 4-1, 4-2, 4-3, and 4-4

(b) Fixed fire protection meeting the requirements of Sections 4-1, 4-2, and 4-5 of this chapter

#### 4-2 Requirements for All Aircraft Loading Walkways.

**4-2.1\*** Interior finish other than textiles of walls and ceilings and walkways shall be Class A as defined in 6-5.3.1 of NFPA 101, *Life Safety Code*, and classified in accordance with NFPA 255, *Standard on Method of Tests of Surface Burning Characteristics of Building Materials*.

**4-2.2** Interior textile finish of walls and ceilings in walkways shall be as limited by 6-5.3.1.5 of NFPA 101, *Life Safety Code*.

**4-2.3** Interior floor finish in walkways shall be Class I as defined in 6-5.4 of NFPA 101, *Life Safety Code*, and classified in accordance with NFPA 253, *Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source*.

**4-2.4** There shall be no windows other than those located in the ramp access service door and in the cab area for the purpose of operating the aircraft loading walkway.

**4-2.5\*** During a ramp fire emergency, walkway interiors shall have a positive air pressure delivered from a source that shall remain uncontaminated.

**4-2.6\*** Any source of negative air pressure in the aircraft loading walkway shall be automatically shut down in the event of a fire emergency.

**4-2.7** Any door in the egress path through the loading walkway to the terminal building shall swing in the direction of egress from the aircraft towards the terminal building and shall be equipped with panic hardware on the aircraft side.

#### 4-2.8 Cab and Rotunda Slit Curtains.

**4-2.8.1** Cab slit curtains and rotunda slit curtains shall meet the requirements of 4-4.8 by one of the following methods:

- (a) Intrinsic structural features
- (b) Fire-resistive coatings
- (c) Automatically activated water cooling systems in accordance with 4-5.2
- (d) Automatically activated fire curtains
- (e) A local application of a foam system in accordance with 4-5.3 under the cab and rotunda that is automatically activated and covers an area extending 15 ft (4.6 m) beyond the perimeter of the cab and rotunda. This shall supersede the 10-ft criteria of 4-5.3.

*Exception:* When the rotunda is located more than 50 ft (16 m) from the fuel fill or fuel vent point of aircraft and the rotunda slit curtain is of noncombustible construction.

#### 4-3 Materials.

**4-3.1** Exterior surfaces of floor, roof, walls, and load-bearing structural members shall be constructed entirely of materials or composite assemblies that maintain the structural integrity and heat transfer characteristics needed to meet the requirements specified in 4-1.1 and Section 4-4.

**4-3.2** Flexible closures, canopies, wipers, and weather-sealing devices shall be subjected to the accelerated weathering procedures specified in Section 8-6 of NFPA 701, *Standard Methods of Fire Tests for Flame-Resistant Textiles and Films*, after which they

shall meet the requirements of 4-4.7 or 4-4.10 of this standard, as applicable.

**4-3.3** The manufacturer shall provide, in writing, the anticipated service life expectancy of components that contribute to fire safety.

#### 4-4 Fire Tests.

##### 4-4.1 Scope of Fire Tests.

**4-4.1.1** Tests shall be conducted to establish the performance of materials and methods of construction, and to verify their structural integrity and heat transfer characteristics so as to satisfy the five-minute exit route criteria specified in 4-1.1.

**4-4.1.2** The test methods specified in this chapter shall be applicable to assemblies of units and to composite assemblies of structural materials for aircraft loading walkways, including walls, girders, beams, slabs, and composite slab and beam assemblies for floor and walls either tested individually as floor or wall panels or as a complete assembly. Also, they shall be applicable to other assemblies and structural units that constitute permanent integral parts of a finished aircraft loading walkway.

**4-4.1.3** The condition of acceptance for tests specified in this section for aircraft loading walkways shall be documented by one of the following methods. Such submittals shall be subject to acceptance by the authority having jurisdiction.

(a) Tests shall be conducted in accordance with the requirements and procedures of Section 4-4.

(b) Evidence of compliance shall be permitted to be achieved by other methods such as modeling, calculation, or testing. The submitter must show that the method used proves that components achieve a level of fire safety at least equal to that produced by the procedure in Section 4-4.

**4-4.1.4** The tests shall register performance during the required period of exposure and shall not be construed as having determined suitability for use after fire exposure.

**4-4.2 Time-Temperature Curve to Be Used.** The conduct of fire tests of materials and construction shall be controlled by the time-temperature curves in Figure 4-4.2 and Table 4-4.2.

##### 4-4.3 Furnace Temperatures.

**4-4.3.1** The temperature fixed by the curve shall be deemed to be the average temperature obtained from the readings of not less than nine thermocouples for a floor or wall section. The thermocouples shall be symmetrically located and distributed to show the temperature near all parts of the sample and shall be partially enclosed in porcelain tubes  $\frac{3}{4}$  in. (19 mm) in outside diameter and  $\frac{1}{8}$  in. (3 mm) in wall thickness with a minimum exposed length of thermocouple wires of  $1\frac{1}{2}$  in. (38 mm). The exposed length of the pyrometer tube and thermocouples in the furnace chamber shall be not less than 12 in. (305 mm). Other types of thermocouples or pyrometers that under test conditions give the same indications as those specified herein within the limit of accuracy that applies for real-time furnace temperature measurements shall be permitted to be used.

**4-4.3.1.1** For floor sections, the junction of the thermocouples shall be placed 12 in. (305 mm) away from the exposed surface of the sample at the beginning of the test and during the test shall not touch the sample as a result of its deflection.

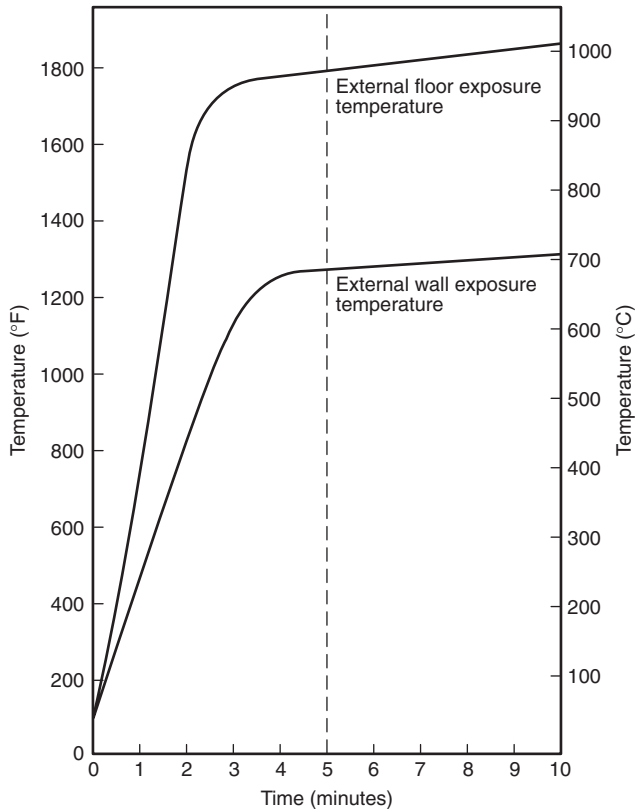


Figure 4-4.2 Typical furnace time-temperature curves for fire testing of aircraft loading walkways. (See Table 4-4.2.)

**4-4.3.1.2** For walls, the thermocouples shall be placed 6 in. (152 mm) away from the exposed face of the sample at the beginning of the test and shall not touch the sample during the test as a result of its deflection.

**4-4.3.2** The temperatures shall be measured and reported at intervals not exceeding 15 seconds.

**4-4.3.3** The accuracy of the furnace control shall be such that at any given time the temperature obtained by averaging the results from the pyrometer readings shall not be less than 90 percent of the temperature curve shown in Figure 4-4.2.

#### 4-4.4 Temperatures of Unexposed Surfaces of Floors and Walls.

**4-4.4.1** Temperatures of unexposed surfaces shall be measured with exposed-type thermocouples placed under felted refractory fiber pads.

**4-4.4.1.1** The refractory fiber pads shall be of flexible, felted material, free of organic additives, and they shall exhibit the following properties:

- Length and width shall be  $6 \pm \frac{1}{8}$  in. ( $152 \pm 3.18$  mm).
- Thickness shall be  $0.375 \pm 0.063$  in. ( $9.5 \pm 1.6$  mm).
- Dry weight shall be  $0.147 \pm 0.053$  lb ( $67 \pm 24$  g).
- Thermal conductivity [at 150°F (66°C)] shall be  $0.37 \pm 0.03$  Btu in./h ft<sup>2</sup>·°F ( $0.053 \pm 0.004$  W/m·K).

Table 4-4.2 Typical Furnace Time-Temperature Gradients for Fire Testing of Aircraft Loading Walkways (See Figure 4-4.2.)

Time Min:Sec	Exposed Floor Sections		Exposed Wall Sections	
	Temperature		Temperature	
	°C	°F	°C	°F
0:00	20	68	20	68
0:20	160	320	90	194
0:40	300	572	165	329
1:00	440	824	235	455
1:20	580	1076	310	590
1:40	720	1328	380	716
2:00	860	1580	450	842
2:20	915	1679	520	968
2:40	940	1724	595	1103
3:00	955	1751	635	1175
3:20	960	1760	660	1220
3:40	965	1769	675	1247
4:00	970	1778	685	1265
4:20	970	1778	690	1274
4:40	975	1787	690	1274
5:00	975	1787	690	1274
5:20	975	1787	695	1283
5:40	980	1796	695	1283
6:00	980	1796	695	1283
6:20	985	1805	700	1292
6:40	985	1805	700	1292
7:00	990	1814	700	1292
7:20	990	1814	705	1301
7:40	995	1823	705	1301
8:00	995	1823	705	1301
8:20	995	1823	710	1310
8:40	1000	1832	710	1310
9:00	1000	1832	710	1310
9:20	1005	1841	715	1319
9:40	1005	1841	715	1319
10:00	1005	1841	715	1319

(e) Hardness indentation on soft face shall be  $0.075 \pm 0.025$  in. ( $1.9 \pm 0.6$  mm). Indentation shall be determined in accordance with ASTM Test Method C569. Modified Brinnell values of hardness are obtained by the following relationship:

$$\text{hardness} = \frac{2.24}{y}$$

where  $y$  = the measured indentation in inches

(f) The pads shall be shaped by wetting, forming, and drying to constant weight to provide complete contact on sharply contoured surfaces.

**4-4.4.1.2** The thickness measurement shall be made under the light load of a  $\frac{1}{2}$ -in. (13-mm) diameter pad of a dial micrometer gauge.

**4-4.4.1.3** The wire leads of the thermocouple shall have an immersion under the pad and shall be in contact with the unexposed surface for not less than  $1\frac{1}{2}$  in. (38 mm). The hot junction of the thermocouple shall be placed approximately under the center of the pad. The outside diameter of protecting or insulating tubes shall be not more than  $\frac{5}{16}$  in. (8 mm). The pad shall be held firmly against the surface, and shall fit closely about the thermocouples. The wires from the thermocouple in the length covered by the pad shall be not heavier

than No. 18 B & S gauge 0.04 in. (1.02 mm) and shall be electrically insulated with heat-resistant and moisture-resistant coatings.

**4-4.4.2** Temperature readings shall be taken at not less than nine points on the surface. Five of these shall be symmetrically located: one to be approximately at the center of the walkway specimen and four to be approximately at the center of its quarter sections. The other four shall be located at the discretion of the testing authority to obtain representative information on the performance of the walkway specimen under test. None of the thermocouples shall be located nearer to the edges of the test specimen than one and one-half times the thickness of the construction, or 12 in. (305 mm). Thermocouples shall not be located opposite or on top of beams, girders, or other structural members.

**4-4.4.3** Temperature readings shall be taken at intervals not exceeding 15 seconds.

**4-4.4.4** Where the conditions of acceptance place a limitation on the temperature of the unexposed surface, the temperature end point of the fire-endurance period shall be determined by the average of the measurements taken at individual points. If a temperature rise of 30 percent in excess of the specified limit occurs at any one of these points, the remainder shall be ignored and the fire-endurance period judged as ended.

#### 4-4.5 Test Specimen.

**4-4.5.1** The test specimen shall be representative of the construction for the classification desired in regard to materials, workmanship, and details such as dimensions of parts and shall be built under conditions representative of actual aircraft loading walkway construction and operation. The physical properties of the materials and ingredients used in the test specimen shall be determined and recorded.

**4-4.5.2** The test specimen shall be protected during and after fabrication in order to ensure normality of its quality and condition at the time of the test. The ambient air temperature at the beginning of the test shall be within the range of 50°F to 90°F (10°C to 32°C). The velocity of air across the unexposed surface of the sample, measured just before the test begins, shall not exceed 4.4 ft/sec (1.3 m/s), as determined by an anemometer placed at right angles to the unexposed surface. If mechanical ventilation is employed during the test, an air stream shall not be directed across the surface of the specimen.

**4-4.5.3\*** The fire-endurance test shall be continued on the specimen with its applied load, if any, until failure occurs, or until the specimen has withstood the test conditions for a period of 10 minutes.

**4-4.5.4** Results shall be reported in accordance with the performance in the tests prescribed in these methods. Time-temperature results shall be reported at 15-second intervals. Reports shall include observations of significant details of the behavior of the material or construction during the test and after the furnace fire is cut off, including information on deformation, spalling, cracking, burning of the specimen or its component parts, continuance of flaming, and production of smoke.

#### 4-4.6 Tests of Walls and Floors.

**4-4.6.1** The dimensions of the sample to be tested shall be determined based upon the construction features of the spe-

cific walkway being tested. The dimensions selected shall ensure that the sample, when tested, will demonstrate the ability of the most critical elements of the walkway to withstand stress concentrations without failure and without separations that would permit fire and smoke intrusion. Verification documentation supporting the selection of the dimensions shall be approved by the authority having jurisdiction.

**4-4.6.2** The effect of exposure to elevated temperatures of working stress seen as worst case load combinations during actual usage shall be accomplished by one of the following two methods:

(a) A superimposed load to the specimen shall be applied in a manner calculated to develop theoretically the design-allowable stresses contemplated by the design during the test described in 4-4.2.

(b) The yield strength of the structural medium shall be correlated to the maximum temperature recorded in 4-4.2. Structural submittals shall be made using this new yield strength showing nonfailure conditions have been met.

Worst-case load combinations shall be derived from the following:

(a) Floor Live Load:	40 lb/ft <sup>2</sup> (195 kg/m <sup>2</sup> )
(b) Roof Load:	25 lb/ft <sup>2</sup> (122 kg/m <sup>2</sup> )
(c) Wind Load:	2.5 lb/ft <sup>2</sup> (61 kg/m <sup>2</sup> )

**4-4.6.3** The test shall be successful when the following conditions of acceptance are met:

(a) The wall or floor section shall have sustained the applied load during the fire-endurance test without passage of flame for a minimum period of five minutes. Flaming shall not appear on the unexposed face.

(b) The maximum allowable surface temperature of the cool side of a wall or floor section shall not exceed 250°F (121°C) during a five-minute exposure as determined by 4-4.4.4.

#### 4-4.7 Tests of Flexible Closures.

**4-4.7.1** The test specimen area exposed to the test fire shall not be less than 2 ft × 2 ft (0.62 m × 0.62 m) square. The test specimen shall be representative of all elements of the flexible closure, including framework assembly and mechanisms for attachment to the aircraft loading walkway.

**4-4.7.2** The test shall be successful when all of the following conditions of acceptance are met:

(a) The test specimen shall have withstood the fire-endurance test as defined by the time-temperature curve for external walkway wall exposure in Figure 4-4.2 without passage of flame for a minimum period of five minutes.

(b) The closure material also shall pass the following test, designed to measure the radiant heat flux to which a human can be subjected while exiting an aircraft under a fuel spill fire emergency condition. A specimen of the closure material that reproduces the most expanded actual field operating configuration, regarding folds and pleats, existing 6 ft (1.8 m) above the floor shall be tested in a furnace. The furnace temperature applied to the exposed exterior surface of the closure material shall be raised in accordance with the time-temperature curve for external walkway wall exposure in Figure 4-4.2. Measurements shall be taken by a radiometer positioned between a minimum distance of 39.4 in. (1 m) and a

maximum distance of 78.7 in. (2 m) away from the cool side surface of the test specimen. The radiometer shall have a view angle small enough such that it “sees” only the test specimen and not the frame or furnace wall. The approximate equivalent human exposure in the walkway shall not exceed 0.65 W/cm<sup>2</sup>. The approximate equivalent human exposure shall be calculated by multiplying the maximum actual radiometer reading for the test in W/cm<sup>2</sup> at the radiometer by

$$\frac{0.31 \left( \tan^2 \frac{\Theta}{2} + 1 \right)}{\tan^2 \frac{\Theta}{2} \tau}$$

where:

$\Theta$  = the total view angle of the test radiometer

$\tau$  = the corrosion for absorption due to humidity

Table 4-4.7.2 shall be used to determine the appropriate  $\tau$ .

Table 4-4.7.2  $\tau$  Factors

Relative Humidity During Test	Distance Source to Sensor		
	1 m	1.5 m	2 m
0 – 25%	0.96	0.95	0.94
25 – 50%	0.94	0.93	0.92
50 – 100%	0.92	0.91	0.90

(c) The framework assembly supporting the closure curtain material and mechanisms for attachment shall be capable of maintaining structural integrity when subjected to the fire defined by the time-temperature curve for external walkway wall exposure in Figure 4-4.2.

#### 4-4.8 Test of Cab and Rotunda Slat Curtains.

**4-4.8.1** The test specimen area exposed to the test fire shall not be less than 2 ft × 2 ft (0.62 m × 0.62 m) square. The test specimen shall be representative of all elements of the cab and rotunda slat curtains, including framework assembly and mechanisms for attachment to the aircraft loading walkway.

**4-4.8.2** For conditions of acceptance, the test sample shall be capable of withstanding the fire-endurance test as defined by the time-temperature curve in Figure 4-4.2 appropriate for the walkway location being tested without passage of flame for a period of five minutes. Flaming shall not appear on the unexposed face.

#### 4-4.9 Tests of Bumpers.

**4-4.9.1\*** Bumper assemblies shall be tested in continuous contact against a simulated aircraft fuselage in a manner representative of intended usage.

**4-4.9.2** The specimen shall be configured in a manner representative of actual fabrication and shall include the bumper proper and mechanism for bumper attachment to the aircraft loading walkway.

**4-4.9.3** For conditions of acceptance, bumpers shall be capable of withstanding the fire-endurance test as defined by the time-temperature curve for external walkway flooring exposure in Figure 4-4.2 without passage of flame for a period of five minutes. Flaming shall not appear on the unexposed face.

#### 4-4.10 Tests of Miscellaneous Seals and Weather-Stripping Assemblies.

**4-4.10.1** The testing laboratory shall construct a steel stud wall assembly consisting of one layer of 1/2-in. Type X gypsum wallboard on the exposed face. A hole shall be framed out in the center of the test wall where another steel stud/gypsum wallboard assembly shall be inserted. The smaller assembly to be inserted into the wall shall be constructed such that the opening between the test wall and the smaller assembly allows the weather stripping or seal material to fill the gap in a manner representative of end-use application. The entire assembly then shall be placed against the furnace for the required exposure.

**4-4.10.2** The size of the test specimen shall not be less than 2 ft (0.62 m) long.

**4-4.10.3** For conditions of acceptance, these components shall be capable of withstanding the fire-endurance test as defined by the time-temperature curve in Figure 4-4.2 appropriate for the walkway location being tested without passage of flame for a period of five minutes. Flaming shall not appear on the unexposed face.

#### 4-5 Fire Suppression Systems.

**4-5.1\*** The fixed fire suppression specified in 4-1.2 shall be provided by one of the following systems:

- (a) Fixed water spray system specified in 4-5.2
- (b) Fixed foam system specified in 4-5.3

**4-5.2** The fixed water spray system shall be of the open head, deluge type, and shall meet the requirements of NFPA 15, *Standard on Water Spray Fixed Systems for Fire Protection*. The system shall be designed so that the water is discharged directly on all walkway outer surfaces and structural members being protected. The system shall be automatically actuated, and designed for a minimum discharge duration of five minutes.

**4-5.3** The fixed foam system shall be adequate to blanket the area under the walkway when positioned at the aircraft exit door(s) and for a distance of approximately 10 ft (3 m) in all directions. The system shall meet the requirements of NFPA 11, *Standard for Low-Expansion Foam*, and NFPA 16, *Standard for the Installation of Deluge Foam-Water Sprinkler Systems and Foam-Water Spray Systems*. The system shall be automatically activated. This system shall be capable of discharging in such a manner that the protected area previously described will be free of fire for a minimum duration of five minutes.

### Chapter 5 Referenced Publications

**5-1** The following documents or portions thereof are referenced within this standard as mandatory requirements and shall be considered part of the requirements of this standard. The edition indicated for each referenced mandatory document is the current edition as of the date of the NFPA issuance of this standard. Some of these mandatory documents might also be referenced in this standard for specific informational purposes and, therefore, are also listed in Appendix B.

**5-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 10, *Standard for Portable Fire Extinguishers*, 1994 edition.

NFPA 11, *Standard for Low-Expansion Foam*, 1994 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1996 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 1996 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 1996 edition.

NFPA 16, *Standard for the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*, 1995 edition.

NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, 1997 edition.

NFPA 54, *National Fuel Gas Code*, 1996 edition.

NFPA 70, *National Electrical Code*, 1996 edition.

NFPA 72, *National Fire Alarm Code*, 1996 edition.

NFPA 82, *Standard on Incinerators and Waste and Linen Handling Systems and Equipment*, 1994 edition.

NFPA 90A, *Standard for the Installation of Air Conditioning and Ventilating Systems*, 1996 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*, 1995 edition.

NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 1994 edition.

NFPA 101, *Life Safety Code*, 1997 edition.

NFPA 220, *Standard on Types of Building Construction*, 1995 edition.

NFPA 253, *Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source*, 1995 edition.

NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, 1996 edition.

NFPA 407, *Standard for Aircraft Fuel Servicing*, 1996 edition.

NFPA 409, *Standard on Aircraft Hangars*, 1995 edition.

NFPA 701, *Standard Methods of Fire Tests for Flame-Resistant Textiles and Films*, 1996 edition.

**5-1.2 ASTM Publications.** American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM Test Method C569, *Standard Test Method for Indentation Hardness of Preformed Thermal Insulations*, 1983.

## Appendix A Explanatory Material

*This appendix is not a part of the recommendations of this NFPA document but is included for informational purposes only.*

**A-1-2** The adequacy and usefulness of airport terminal buildings depends, to a large extent, on the fire resistance of their construction and the fire protection provided within the buildings.

The provision of aircraft rescue and fire-fighting equipment at airports meeting the recommendations of NFPA 403, *Standard for Aircraft Rescue and Fire Fighting Services at Airports*, and

NFPA 414, *Standard for Aircraft Rescue and Fire Fighting Vehicles*, will be useful in controlling ramp fires. The provision of hydrants on the ramp side of airport terminal buildings will assist in meeting supplemental fire protection needs in this area.

**A-1-4 Airport Terminal Building.** The term “Terminal” is sometimes applied to airport facilities other than those serving passengers, such as cargo and freight facilities and fueling-handling facilities. These facilities are covered by other NFPA standards such as NFPA 513, *Standard for Motor Freight Terminals*, and NFPA 30, *Flammable and Combustible Liquids Code*.

**A-1-4 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A-1-4 Authority Having Jurisdiction.** The phrase “authority having jurisdiction” is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

**A-1-4 Listed.** The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

**A-2-1.1** Building construction types are defined in NFPA 220, *Standard on Types of Building Construction*. The following material is extracted verbatim from NFPA 220, 1995 edition and is included here as a convenience for users of this standard. Any requests for Formal Interpretations (FIs) or Tentative Interim Amendments (TIAs) on the following material should be directed to the Technical Committee on Building Construction.

**3-1 Type I (443 or 332).** Type I construction shall be that type in which the structural members, including walls, columns, beams, girders, trusses, arches, floors, and roofs, are of approved noncombustible or limited-combustible materials and shall have fire resistance ratings not less than those specified in Table 3-1.

**Table 3-1 Fire-Resistance Ratings (in Hours) for Type I Through Type V Construction**

	Type I		Type II			Type III		Type IV	Type V	
	443	332	222	111	000	211	200	2HH	111	000
Exterior Bearing Walls – Supporting more than one floor, columns, or other bearing walls.....	4	3	2	1	0 <sup>1</sup>	2	2	2	1	0 <sup>1</sup>
Supporting one floor only.....	4	3	2	1	0 <sup>1</sup>	2	2	2	1	0 <sup>1</sup>
Supporting a roof only.....	4	3	1	1	0 <sup>1</sup>	2	2	2	1	0 <sup>1</sup>
Interior Bearing Walls – Supporting more than one floor, columns, or other bearing walls.....	4	3	2	1	0	1	0	2	1	0
Supporting one floor only.....	3	2	2	1	0	1	0	1	1	0
Supporting roofs only.....	3	2	1	1	0	1	0	1	1	0
Columns – Supporting more than one floor, columns, or other bearing walls.....	4	3	2	1	0	1	0	H <sup>2</sup>	1	0
Supporting one floor only.....	3	2	2	1	0	1	0	H <sup>2</sup>	1	0
Supporting roofs only.....	3	2	1	1	0	1	0	H <sup>2</sup>	1	0
Beams, Girders, Trusses & Arches – Supporting more than one floor, columns, or other bearing walls.....	4	3	2	1	0	1	0	H <sup>2</sup>	1	0
Supporting one floor only.....	3	2	2	1	0	1	0	H <sup>2</sup>	1	0
Supporting roofs only.....	3	2	1	1	0	1	0	H <sup>2</sup>	1	0
Floor Construction	3	2	2	1	0	1	0	H <sup>2</sup>	1	0
Roof Construction	2	1½	1	1	0	1	0	H <sup>2</sup>	1	0
Exterior Nonbearing Walls	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>	0 <sup>1</sup>

Shaded areas represent those members that shall be permitted to be of approved combustible material.

<sup>1</sup>Requirements for fire resistance of exterior walls, the provision of spandrel wall sections, and the limitation or protection of wall openings are not related to construction type. They need to be specified in other standards and codes, where appropriate, and may be required in addition to the requirements of NFPA 220, *Standard on Types of Building Construction*, for the construction type.

<sup>2</sup>"H" indicates heavy timber members; see NFPA 220, *Standard on Types of Building Construction*, for requirements.

**3-2 Type II (222, 111, or 000).** Type II construction shall be that type not qualifying as Type I construction in which the structural members, including walls, columns, beams, girders, trusses, arches, floors, and roofs, are of approved noncombustible or limited-combustible materials and shall have fire resistance ratings not less than those specified in Table 3-1.

**3-3 Type III (211 or 200).** Type III construction shall be that type in which exterior walls and structural members that are portions of exterior walls are of approved noncombustible or limited-combustible materials, and interior structural members, including walls, columns, beams, girders, trusses, arches, floors, and roofs, are entirely or partially of wood of smaller dimensions than required for Type IV construction or of approved noncombustible, limited-combustible, or other approved combustible materials. In addition, structural members shall have fire resistance ratings not less than those specified in Table 3-1.

**3-4\* Type IV (2HH).**

**3-4.1** Type IV construction shall be that type in which exterior and interior walls and structural members that are portions of such walls are of approved noncombustible or limited-combustible materials. Other interior struc-

tural members, including columns, beams, girders, trusses, arches, floors, and roofs, shall be of solid or laminated wood without concealed spaces and shall comply with the provisions of 3-4.2 through 3-4.6. In addition, structural members shall have fire resistance ratings not less than those specified in Table 3-1.

*Exception No. 1: Interior columns, arches, beams, girders, and trusses of approved materials other than wood shall be permitted, provided they are protected to provide a fire resistance rating of not less than 1 hr.*

*Exception No. 2: Certain concealed spaces shall be permitted by the exception to 3-4.4.*

**3-4.2** Wood columns supporting floor loads shall be not less than 8 in. (203 mm) in any dimension; wood columns supporting roof loads only shall be not less than 6 in. (152 mm) in the smallest dimension and not less than 8 in. (203 mm) in depth.

**3-4.3** Wood beams and girders supporting floor loads shall be not less than 6 in. (152 mm) in width and not less than 10 in. (254 mm) in depth; wood beams and girders and other roof framing, supporting roof loads only, shall be not less than 4 in. (102 mm) in width and not less than 6 in. (152 mm) in depth.

**3-4.4** Framed or glued laminated arches that spring from grade or the floor line and timber trusses that support floor loads shall be not less than 8 in. (203 mm) in width or depth. Framed or glued laminated arches for roof construction that spring from grade or the floor line and do not support floor loads shall have members not less than 6 in. (152 mm) in width and not less than 8 in. (203 mm) in depth for the lower half of the member height and not less than 6 in. (152 mm) in depth for the upper half of the member height. Framed or glued laminated arches for roof construction that spring from the top of walls or wall abutments and timber trusses that do not support floor loads shall have members not less than 4 in. (102 mm) in width and not less than 6 in. (152 mm) in depth.

*Exception: Spaced members shall be permitted to be composed of two or more pieces not less than 3 in. (76 mm) in thickness where blocked solidly throughout their intervening spaces or where such spaces are tightly closed by a continuous wood cover plate not less than 2 in. (51 mm) in thickness, secured to the underside of the members.*

Splice plates shall be not less than 3 in. (76 mm) in thickness.

**3-4.5** Floors shall be constructed of splined or tongued and grooved plank not less than 3 in. (76 mm) in thickness that is covered with 1-in. (25-mm) tongue and groove flooring, laid crosswise or diagonally to the plank, or with 1/2-in. (12.7-mm) plywood; or they shall be constructed of laminated planks not less than 4 in. (102 mm) in width, set close together on edge, spiked at intervals of 18 in. (457 mm), and covered with 1-in. (25-mm) tongue and groove flooring, laid crosswise or diagonally to the plank, or with 1/2-in. (12.7-mm) plywood.

**3-4.6** Roof decks shall be constructed of splined or tongued and grooved plank not less than 2 in. (51 mm) in thickness; or of laminated planks not less than 3 in. (76 mm) in width, set close together on edge, and laid as required for floors; or of 1 1/8-in. (28.6-mm) thick interior plywood (exterior glue); or of approved noncombustible or limited-combustible materials of equivalent fire durability.

NOTE: The dimensions used for sawn and glued laminated lumber in Section 3-4 are nominal dimensions.

**3-5 Type V (111 or 000).** Type V construction shall be that type in which exterior walls, bearing walls, columns, beams, girders, trusses, arches, floors, and roofs are entirely or partially of wood or other approved combustible material smaller than material required for Type IV construction. In addition, structural members shall have fire resistance ratings not less than those specified in Table 3-1.

**A-2-1.2** Furniture, floor and wall coverings, and other furnishings in airport terminal occupancies, including passenger holding lounges, waiting areas, restaurant dining rooms, bars, retail stores, etc., should not be made of materials that have high combustibility or smoke-development characteristics, or both. Examples of materials that have high combustibility or smoke-development characteristics, or both, include some plastic foams, latex-rubber foam, some plastics, and some synthetic fibers. Such materials have a tendency to release combustible gases at relatively low temperatures, making them easily ignitable. These materials also release high amounts of

heat energy at rapid rates when burning, thereby contributing greatly to fire propagation.

**A-2-1.5** The use of glass and other glazing materials in airport terminal building walls facing the ramp should be avoided if the fueling ramp drainage inlets or the probable points of fuel spillage from aircraft are less than 100 ft (30.5 m) from such walls. This standard prohibits locating drainage inlets less than 50 ft (15.2 m) from any airport terminal building walls.

This recommendation is made because the radiant heat release from a serious fuel spill fire can be expected to break glass windows up to 75 ft (22.9 m) away and cause ignition of combustible materials within the building.

Protection provided by automatically operated outside spray nozzles is not intended to provide a safe refuge area for occupants. The degree of protection at the opening is intended to provide a period of time for the safe egress of building occupants in the vicinity of the exposed window area.

The presence of automatic sprinkler protection in the airport terminal building would be expected to control a fire initiated in the building due to an exposure fire. Glazing material above the 7-ft (2.1-m) level will not cause immediate exposure to building occupants.

Care should be exercised in the selection and adjustment of detection equipment to ensure proper operation and to guard against inadvertent operation of the system from normally fluctuating conditions. Due to the normal activity on the airport ramp, the radiated energy of a spill fire might not be received at a particular detector location but can still expose the building wall.

The aircraft terminal building is fairly unique since there can be a large population in the terminal building at the same time that a high hazard exposes the terminal. This combination presents the potential for a serious emergency situation.

An exposure evaluation should be developed for potential fuel spill points more than 50 ft (15.2 m) but less than or equal to 100 ft (30.5 m) from the airport terminal building. The exposure evaluation should describe the location and severity of potential fuel spill points and the design features that control exposure fire damage to the airport terminal building and occupants. Catastrophic crashes between aircraft or aircraft and the building are not part of the evaluation.

The exposure evaluation should include consideration of each of the following:

- (a) Fuel spill points
- (b) Fuel spill rates
- (c) Fuel spill pool size
- (d) Ramp drainage design
- (e) Exposed wall construction
- (f) Wall openings (windows, doors, etc.)
- (g) Interior building fire protection features

The many factors affecting the exposure make each facility layout a different design problem. The building design, aircraft fueling ramp design, aircraft fueling system, and aircraft fueling ramp drainage system will affect the exposure.

The building design features affecting the degree of exposure include building construction characteristics, the size of windows facing the ramp, the presence of automatic sprinkler protection, and the exit arrangements. The exposed wall will provide a different degree of protection to the building interior and building occupants depending on the building wall construction material.



The presence of openings, particularly glass, will significantly increase the radiated energy inside the building. The extent to which the radiated energy transmission is affected will depend on the size of the opening, the opening location with respect to the spill fire, and the building arrangement inside the opening.

The aircraft fueling ramp design will affect the size and duration of a fuel spill fire. Both the direction and rate of drainage can influence the fire exposure to the airport terminal building. When the characteristics of the ramp design and the ramp drainage system are considered together, the variables, such as ramp construction material, ramp slope, drain inlet location, and drainage system capacity, will affect the exposure. Ramp drainage trenches present a different exposure to the airport terminal building wall from drain inlets to an underground piping system.

Aircraft fueling systems are generally fixed piping systems with strategically located fuel hydrants. Fuel servicing vehicles serve as the transfer mechanism between the fixed piping system and the aircraft. Refer to NFPA 407, *Standard for Aircraft Fuel Servicing*, for design considerations used in the airport fueling systems. Smaller or older airports may use tanker trucks. Tanker trucks are also used as backup to the fixed piping systems. The presence of a tanker truck at the aircraft puts a larger quantity of fuel on the ramp.

Exposure fire damage can be minimized in three different ways: physical separation, fire-resistance-rated exterior wall construction, and fire suppression systems. These protection methods can be utilized singularly or in combination.

**A-2-2.2** Examples of points of flammable vapor release are fuel tank vent openings and fuel hydrant pits. Air supply intake and exhaust openings for air conditioning or ventilating equipment serving the terminal building should not be located on the ramp side of an airport terminal building. Fixed air conditioning and ventilating equipment serving aircraft only should be in a room having no openings communicating with the remainder of the terminal building.

**A-2-2.3** Rooms containing coal-, gas-, or oil-fired equipment, or any room containing any other open flame device, should not have openings on the ramp side of the building. Combustion and ventilation air should be supplied from the street side or roof of the building or through a gravity louver from a non-hazardous area in the building.

**A-2-3.2** The hazards to persons from jet intakes and blast, noise, propellers, etc., on the ramp should be taken into consideration in locating emergency exit points leading to ramps from the airport terminal building. A means of notification of unauthorized usage (such as an alarm system) of these emergency exits may be desirable.

**A-2-5.1** The assembly portion of the terminal building may include areas such as the concourse waiting areas, baggage claim areas, and restaurants. This should exclude the kitchens, toilets, small office areas, and other areas not normally accessible to the public.

**A-2-5.1.2** The exposure to the airport terminal building from the airport ramp is significant. The number of building sprinklers operating from the exposure fire may be greater than from an internal ignition source.

**A-2-5.2.2** If the public fire department is responding to the “street” side of the airport terminal building, timely access to the normal alarm receiving point may be limited by emergency conditions or distance. Planned radio communication with a constantly attended alarm receiving point can assist in a more efficient response by the public fire department. The remote annunciator on the “street” side of the terminal building can provide building condition information if not otherwise available.

**A-2-5.5.1** Valves should be installed to facilitate proper control and should be based on a calculation of the number of units (suppression systems and hydrants) that would be impaired when portions of the system are out of service for repair, maintenance, modification, or expansion. Valves should be so located and identified as to be readily accessible for operation. Particular attention should be given to valving the following locations:

- (a) Points of connection of supplies to loops or grids
- (b) Intervals in main loop
- (c) Grid intersections
- (d) Beginnings of laterals
- (e) Each connection to hydrants

General fire flow requirements at airports should be based on the maximum fire flow demands (automatic sprinklers, hose, and supplemental systems) anticipated. To determine actual demands, the appropriate NFPA standard should be consulted. Table A-2-5.5.1 lists the range of fire flows and is given only as a guide.

Table A-2-5.5.1

Building— Occupancy	Reference to Other Standards	Range of Fire Flows (sprinklers, hose, supplemental)
Terminal	NFPA 13, NFPA 15, and NFPA 416	1000 gpm – 3500 gpm
Hangar	NFPA 409	A wide range exists. For large hangars, this value could approximate 25,000 gpm
Cargo	NFPA 13, NFPA 15, NFPA 231, and NFPA 231C	1500 gpm – 4000 gpm

**A-2-5.5.2** Hydrants should be placed in strategic locations on the loops or grids. Operational requirements should be considered when determining hydrant locations on or near taxiways and runways where snow and ice may be present.

**A-2-5.5.3** All hydrants should be flushed and all valves operated at least once a year.


After extensive changes to the airport water supply system, full flow tests should be made in the areas affected to ensure that adequacy has been retained or expected improvements have been obtained.

Fire pumps or spare pumps should be given turnover tests at least weekly and full flow tests at least annually. Internal combustion engines driving pumps should be run once a week for at least one-half hour each time.


**A-3-1.1** Consideration should be given to the hydraulic problem in disposal of surface water, safe disposal of fuel that might be spilled on the ramp, and the gradient to be overcome in the movement of aircraft. A ratio of 40,000 ft<sup>2</sup> (3716 m<sup>2</sup>) per drain-age inlet should not be exceeded with minimum flow distances

to drains, but drain inlets should be located so as not to endanger aircraft placements within the ramp area so described.

**A-3-1.2** Figures A-3-1.2(a) and (b) illustrate two possible fueling ramp drainage arrangements.

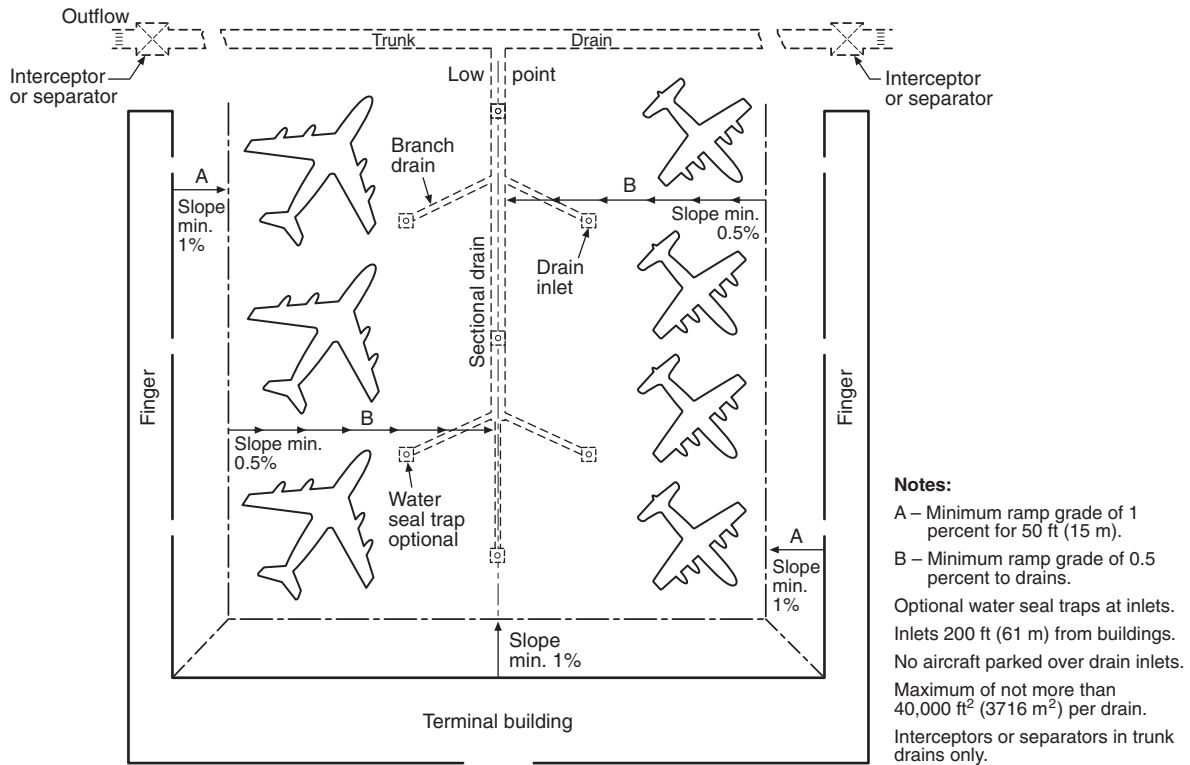

**Figure A-3-1.2(a)** One possible arrangement of an aircraft fueling ramp drainage system using the optional trapped drain inlets.

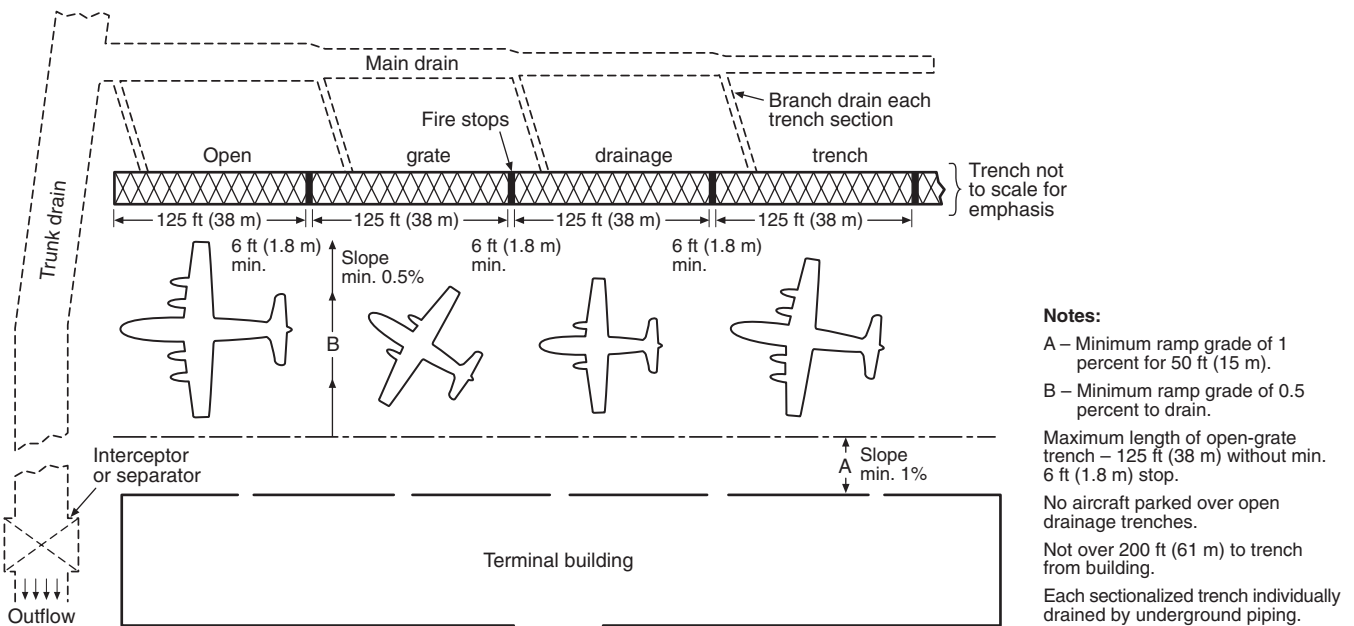

**Figure A-3-1.2(b)** Another possible arrangement of an aircraft fueling ramp drainage system using an open-grate drainage trench.

**A-3-1.7** The individual drain is intended to prevent flow of a spill in one trench from flowing through other trenches. Refer to Figure A-3-1.2(b).

**A-3-2.1** It is suggested that maintenance checks be conducted at least four times a year and more often if climatic or other local conditions dictate.

**A-4-2.1 Interior Atmospheres.** Fire tests have shown that smoke and toxic products generated within the walkway from the decomposition of certain materials can hinder the egress of passengers from an aircraft during a fire emergency. Existing technology does not permit establishment of performance criteria for acceptable levels of smoke density and toxic products. Where the tests specified indicate that materials used in walkway construction can degrade, thermal barriers or insulation should be used to reduce the rate of temperature rise and to delay the decomposition of susceptible materials. Of particular concern are those materials used in floor construction, such as plywood and floor coverings. The insulation materials used should produce minimal smoke under fire exposure conditions.

**A-4-2.5** The source of uncontaminated air is normally from the airport terminal building.

**A-4-2.6** Aircraft loading walkways can be used for a return air plenum as part of a system that provides ventilation for the aircraft. This system can create a positive or negative pressure in the walkway during normal operation and might use air from the ramp for make-up. Systems of this type, as well as any exhaust fans on the walkway, are therefore to be automatically shut down in the event of a fire emergency outlined in 4-1.1.

**A-4-4.5.3** The 10-minute fire endurance test period specified is to give those conducting the tests a better opportunity to discriminate between different test samples.

**A-4-4.9.1** A suggested test configuration is to construct two steel stud frames of suitable size to cover the test furnace when laying side-by-side and flat. On the exposed face of each frame, one layer of 1/2-in. Type X gypsum board should be fastened to the steel stud framing. To the edge of one frame, the bumper assembly should be fastened in a manner representative of end-use application. To the edge of the other frame, a sheet of 1/2-in. thick steel having dimensions such that there is a minimum of 6-in. of steel extending past the bumper assembly in all directions should be fastened to the steel studs. The steel plate is used to simulate the aircraft sidewall. The two frames are brought together such that the bumper assembly is placed in firm contact with the simulated aircraft sidewall and the two frames are fastened together. This unit becomes the test assembly and is placed on the test furnace for the fire exposure period. (See Figure A-4-4.9.1 for a sketch of the test assembly.)

**A-4-5.1 Fire Protection System Actuation Design Recommendation.** The design of automatic actuation equipment should take into consideration the possibility of heat or pressure sources that could exist in the areas where these systems are installed (e.g., operation of turbine engines in the vicinity,

heat-creating equipment on the ramp, hot air curtains at terminal openings, etc.).

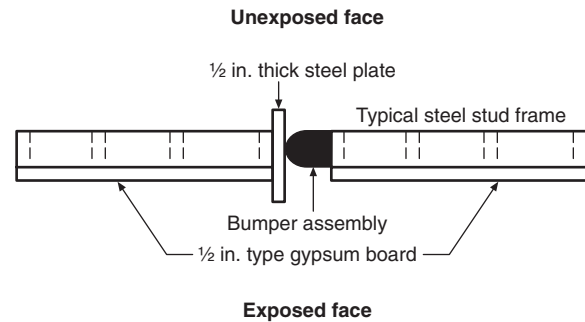


Figure A-4-4.9.1 Proposed method for testing of bumper assemblies.

## Appendix B Referenced Publications

**B-1** The following documents or portions thereof are referenced within this standard for informational purposes only and are thus not considered part of the requirements of this standard unless also listed in Chapter 5. The edition indicated here for each reference is the current edition as of the date of the NFPA issuance of this standard.

**B-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 30, *Flammable and Combustible Liquids Code*, 1996 edition.

NFPA 220, *Standard on Types of Building Construction*, 1995 edition.

NFPA 403, *Standard for Aircraft Rescue and Fire Fighting Services at Airports*, 1993 edition.

NFPA 407, *Standard for Aircraft Fuel Servicing*, 1996 edition.

NFPA 414, *Standard for Aircraft Rescue and Fire Fighting Vehicles*, 1995 edition.

NFPA 513, *Standard for Motor Freight Terminals*, 1994 edition.

**B-1.2 Other Publications.**

**B-1.2.1 References on Heat Exposures to Man.** "Effects of Extreme Heat on Man," Buettner, K. (PB 16.026 U.S. Dept. of Commerce, FSTI), *Journal of the American Medical Association*, Vol. 144, No. 9, pp. 732-738 (October 28, 1950).

*Tolerances to Thermal Extremes in Aerospace Activities (AM 70-22)*, Office of Aviation Medicine, U.S. Dept. of Transportation, FAA (December, 1970).

*Flight Surgeon's Guide*, Department of the Air Force (AFP-161-18), pp. 5-7 (December 27, 1968).

# Index

© 1997 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

## -A-

<b>Air conditioning equipment</b> .....	2-2.1 to 2-2.3, A-2-2.2 to A-2-2.3
<b>Air pressure, aircraft loading walkways</b> .....	4-2.5 to 4-2.6, A-4-2.5 to A-4-2.6
<b>Air supply intake openings</b> .....	2-2.2, A-2-2.2
<b>Aircraft fueling facilities</b> .....	2-1.3, A-2-1.5
<b>Aircraft fueling ramps</b>	
Definition .....	1-4
Design .....	2-1.3, A-2-1.5
Drainage .....	Chap. 3, A-3
Inlets .....	3-1.1 to 3-1.3, A-2-1.5, A-3-1.1 to A-3-1.2
Maintenance .....	3-2, A-3-2.1
Trenches .....	3-1.2, 3-1.7, A-2-1.5, A-3-1.2, A-3-1.7
Exposure to terminal from .....	A-2-1.5
Fuel spill fires and .....	A-2-1.5
Slope .....	3-1.1, A-3-1.1
<b>Aircraft loading walkways</b> .....	Chap. 4, A-4
Basic design .....	4-1
Definition .....	1-4
Fire protection .....	4-1.2(b), 4-2.8.1(e), 4-5, A-4-5.1
Fire tests .....	<i>see</i> Fire tests, aircraft loading walkways
Materials .....	4-3
Requirements .....	4-2, A-4-2
<b>Airport drainage system</b>	
Building drainage systems .....	3-1.4
Containment facility .....	3-1.5
Flushing .....	3-1.6, 3-2.2
Maintenance .....	3-2, A-3-2.1
Separators .....	3-1.5, 3-2, A-3-2.1
<b>Airport ramps</b> .....	<i>see also</i> Aircraft fueling ramps
Definition .....	1-4
Electrical service rooms located near .....	2-4.2
Exits onto .....	2-3.2, A-2-3.2
<b>Airport terminal buildings</b> .....	Chap. 2, A-2
Construction .....	<i>see</i> Construction
Definition .....	1-4, A-1-4
Electrical installations .....	2-4
Exits .....	2-3, A-2-1.5, A-2-3.2
Fire protection .....	2-1.5, 2-5, A-2-1.5, A-2-5
Heating, ventilating, and air conditioning (HVAC) systems .....	2-2, A-2-2.2
<b>Alarm systems, fire</b> .....	2-5.2, A-2-5.2.2
<b>Annunciation at front entrance</b> .....	2-5.2.2, A-2-5.2.2
<b>Applicability of standard</b> .....	1-3
<b>Approved (definition)</b> .....	1-4, A-1-4
<b>Authority having jurisdiction (definition)</b> .....	1-4, A-1-4

## -B-

<b>Belowgrade construction</b> .....	2-1.4
<b>Boilers</b> .....	2-2.4
<b>Bumpers, tests of</b> .....	4-4.9, A-4-4.9.1

## -C-

<b>Cabs, aircraft loading walkway</b>	
Slat curtains .....	4-2.8, 4-4.8
Windows in .....	4-2.4
<b>Chimneys/stacks</b> .....	2-2.4

<b>Coal-fired equipment, location of</b> .....	2-2.3, A-2-2.3
<b>Communication systems</b> .....	2-5.2, A-2-5.2.2
<b>Construction</b>	
Aircraft fueling facilities .....	2-1.3, A-2-1.5
Aircraft loading walkways .....	4-1
Fire tests .....	<i>see</i> Fire tests, aircraft loading walkways
Interior finish .....	4-2.1 to 4-2.4, A-4-2.1
Materials .....	4-3
Airport terminal buildings	
Belowgrade areas .....	2-1.4
Interior finish .....	2-1.2, A-2-1.2
Types of construction allowed .....	2-1.1, A-2-1.1
<b>Covered plane-loading positions</b> .....	2-5.1.3
<b>Curtains</b>	
Cab and rotunda slat .....	4-2.8, 4-4.8
Fire, automatic .....	4-2.8.1(d)

## -D-

<b>Definitions</b> .....	1-4, A-1-4
<b>Design requirements</b> .....	<i>see</i> Construction
<b>Detection systems</b> .....	2-1.5, A-2-1.5
<b>Doors</b> .....	<i>see also</i> Exits
Aircraft loading walkways .....	4-2.4, 4-2.7
<b>Drainage</b>	
Aircraft fueling ramps .....	<i>see</i> Aircraft fueling ramps
Airport .....	<i>see</i> Airport drainage system

## -E-

<b>Electrical installations</b> .....	2-4
<b>Exhaust hoods</b> .....	2-2.6
<b>Exhaust openings</b> .....	2-2.2, A-2-2.2
<b>Exits</b> .....	2-3, A-2-1.5, A-2-3.2
<b>Exposure fire</b>	
Aircraft loading walkways .....	4-1.1
Building sprinklers operating from .....	A-2-5.1.2
Minimizing damage from .....	A-2-1.5
<b>Extinguishers, portable fire</b> .....	2-5.6

## -F-

<b>Fire curtains, automatic</b> .....	4-2.8.1(d)
<b>Fire hydrants</b> .....	2-5.3, 2-5.5.2, A-2-5.5.2 to A-2-5.5.3
<b>Fire protection systems</b>	
Aircraft loading walkways .....	4-1.2(b), 4-2.8.1(e), 4-5, A-4-5.1
Airport terminal buildings .....	2-1.5, 2-5, A-2-1.5, A-2-5
Covered plane-loading positions .....	2-5.1.3
<b>Fire pumps</b> .....	A-2-5.5.3
<b>Fire shutters, automatic</b> .....	2-1.5
<b>Fire tests, aircraft loading walkways</b> .....	4-4, A-4-4.5.3, A-4-4.9.1
Bumpers .....	4-4.9, A-4-4.9.1
Cab and rotunda slat curtains .....	4-4.8
Flexible closures .....	4-4.7
Floors .....	4-4.3.1, 4-4.4, 4-4.6
Furnace temperature .....	4-4.3
Scope of .....	4-4.1
Seals, miscellaneous .....	4-4.10
Specimens, test .....	4-4.5, A-4-4.5.3

Temperatures of unexposed surfaces .....	4-4.4
Time-temperature curve to be used .....	4-4.2
Walls .....	4-4.3.1, 4-4.4, 4-4.6
Weather-stripping assemblies .....	4-4.10
<b>Flammable vapor releases</b> .....	<i>see</i> Vapor releases, flammable
<b>Flexible closures, test of</b> .....	4-4.7
<b>Floors, tests of</b> .....	4-4.3.1, 4-4.4, 4-4.6
<b>Foam systems, aircraft loading walkways</b> .....	4-2.8.1(e), 4-5.1, 4-5.3, A-4-5.1
<b>Fuel hydrants</b> .....	A-2-1.5, A-2-2.2
<b>Fuel spill points, potential</b> .....	<i>see</i> Potential fuel spill points
<b>Fuel tank vent openings</b> .....	A-2-2.2
<b>Furnishings, requirements for</b> .....	A-2-1.2

**-G-**

<b>Gas-fired equipment, location of</b> .....	2-2.3, A-2-2.3
<b>Glazing materials, use of</b> .....	2-1.5, A-2-1.5

**-H-**

<b>Heating, ventilating, and air conditioning (HVAC) systems</b> .....	2-2, A-2-2.2 to A-2-2.3
<b>Hoods, exhaust</b> .....	2-2.6

**-I-**

<b>Incinerators</b> .....	2-2.4 to 2-2.5
<b>Interior finish</b> .....	2-1.2, 4-2.1 to 4-2.3, A-2-1.2, A-4-2.1

**-K-**

<b>Kitchens, ventilating equipment for</b> .....	2-2.6
--	-------

**-L-**

<b>Listed (definition)</b> .....	1-4, A-1-4
----------------------------------	------------

**-M-**

<b>Manual fire alarm pull stations</b> .....	2-5.2.1
--	---------

**-O-**

<b>Oil-fired equipment, location of</b> .....	2-2.3, A-2-2.3
---	----------------

**-P-**

<b>Potential fuel spill points</b>	
Definition .....	1-4
Exposure evaluation .....	A-2-1.5
Protection for .....	2-1.5, A-2-1.5
<b>Purpose of standard</b> .....	1-2, A-1-2

**-R-**

<b>Radio communication</b> .....	A-2-5.2.2
<b>Referenced publications</b> .....	Chap. 5, App. B
<b>Rotunda slat curtains</b> .....	4-2.8, 4-4.8

**-S-**

<b>Satellites (definition)</b> .....	1-4
<b>Scope of standard</b> .....	1-1
<b>Seals, tests of</b> .....	4-4.10
<b>Shall (definition)</b> .....	1-4
<b>Should (definition)</b> .....	1-4
<b>Sprinkler systems</b> .....	2-5.1, A-2-1.5, A-2-5.1.2
Covered plane-loading positions .....	2-5.1.3
Passenger handling areas .....	2-5.1.1
<b>Standpipe and hose systems</b> .....	2-5.4
<b>Suppression systems</b> .....	<i>see</i> Foam systems; Sprinkler systems; Water spray systems

**-T-**

<b>Tanker trucks</b> .....	A-2-1.5
<b>Tests, fire</b> .....	<i>see</i> Fire tests, aircraft loading walkways

**-V-**

<b>Vapor releases, flammable</b> .....	2-2.2 to 2-2.4, 3-1.4, A-2-2.2 to A-2-2.3
<b>Ventilating systems</b> .....	2-2.1 to 2-2.3, A-2-2.2 to A-2-2.3
Aircraft loading walkways .....	4-2.5 to 4-2.6, A-4-2.6
Belowgrade areas .....	2-1.4
Electrical installations .....	2-4.2
Exhaust hoods .....	2-2.6

**-W-**

<b>Walls, tests of</b> .....	4-4.3.1, 4-4.4, 4-4.6
<b>Water cooling systems, automatic</b> .....	4-2.8.1(c)
<b>Water spray systems</b>	
Aircraft loading walkways .....	4-5.1 to 4-5.2, A-4-5.1
Airport terminal buildings .....	2-1.5, A-2-1.5
<b>Water supply requirements, fire protection</b> .....	2-5.5, A-2-5.5
<b>Weather-stripping assemblies, tests of</b> .....	4-4.10